COX WOOD OF VIRGINIA
PERMIT # VA0081213
PROCESS FLOW DIAGRAM

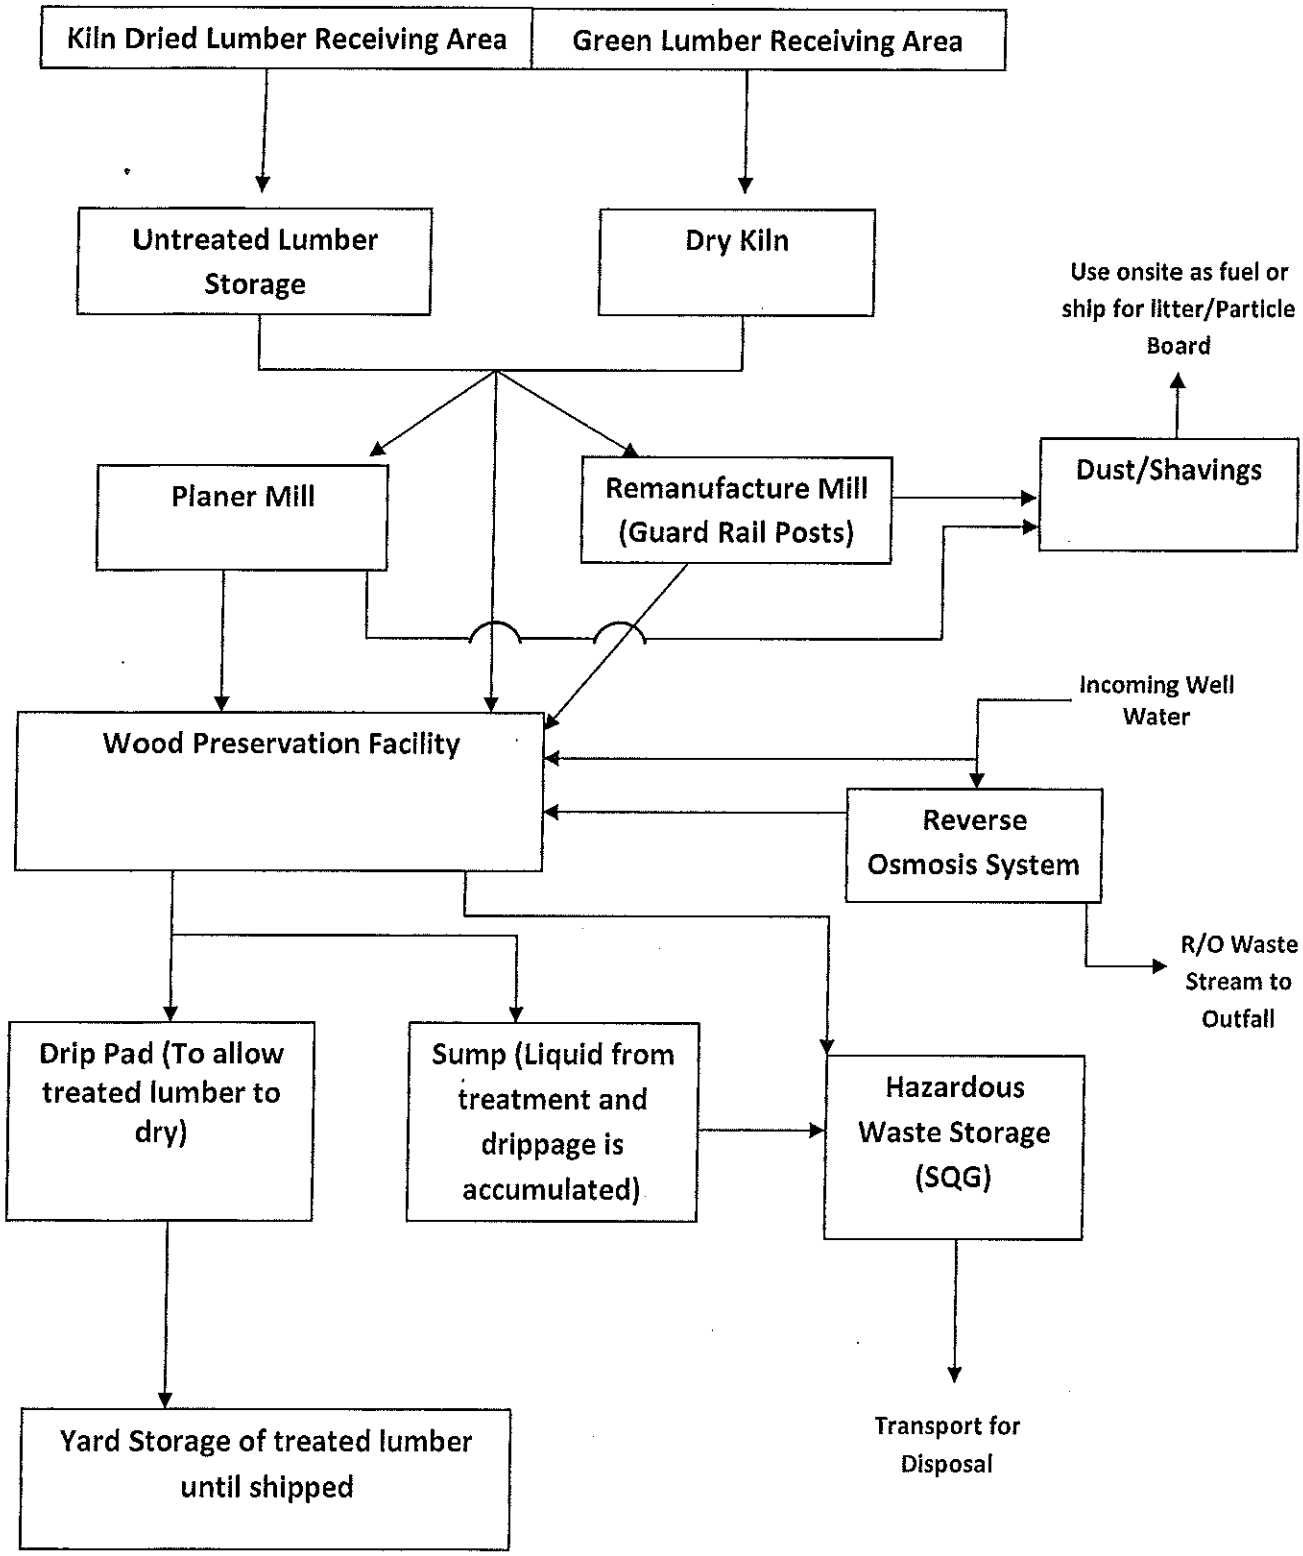

COX WOOD OF VIRGINIA
PERMIT # VA0081213
TREATMENT PLANT DIAGRAM 2008

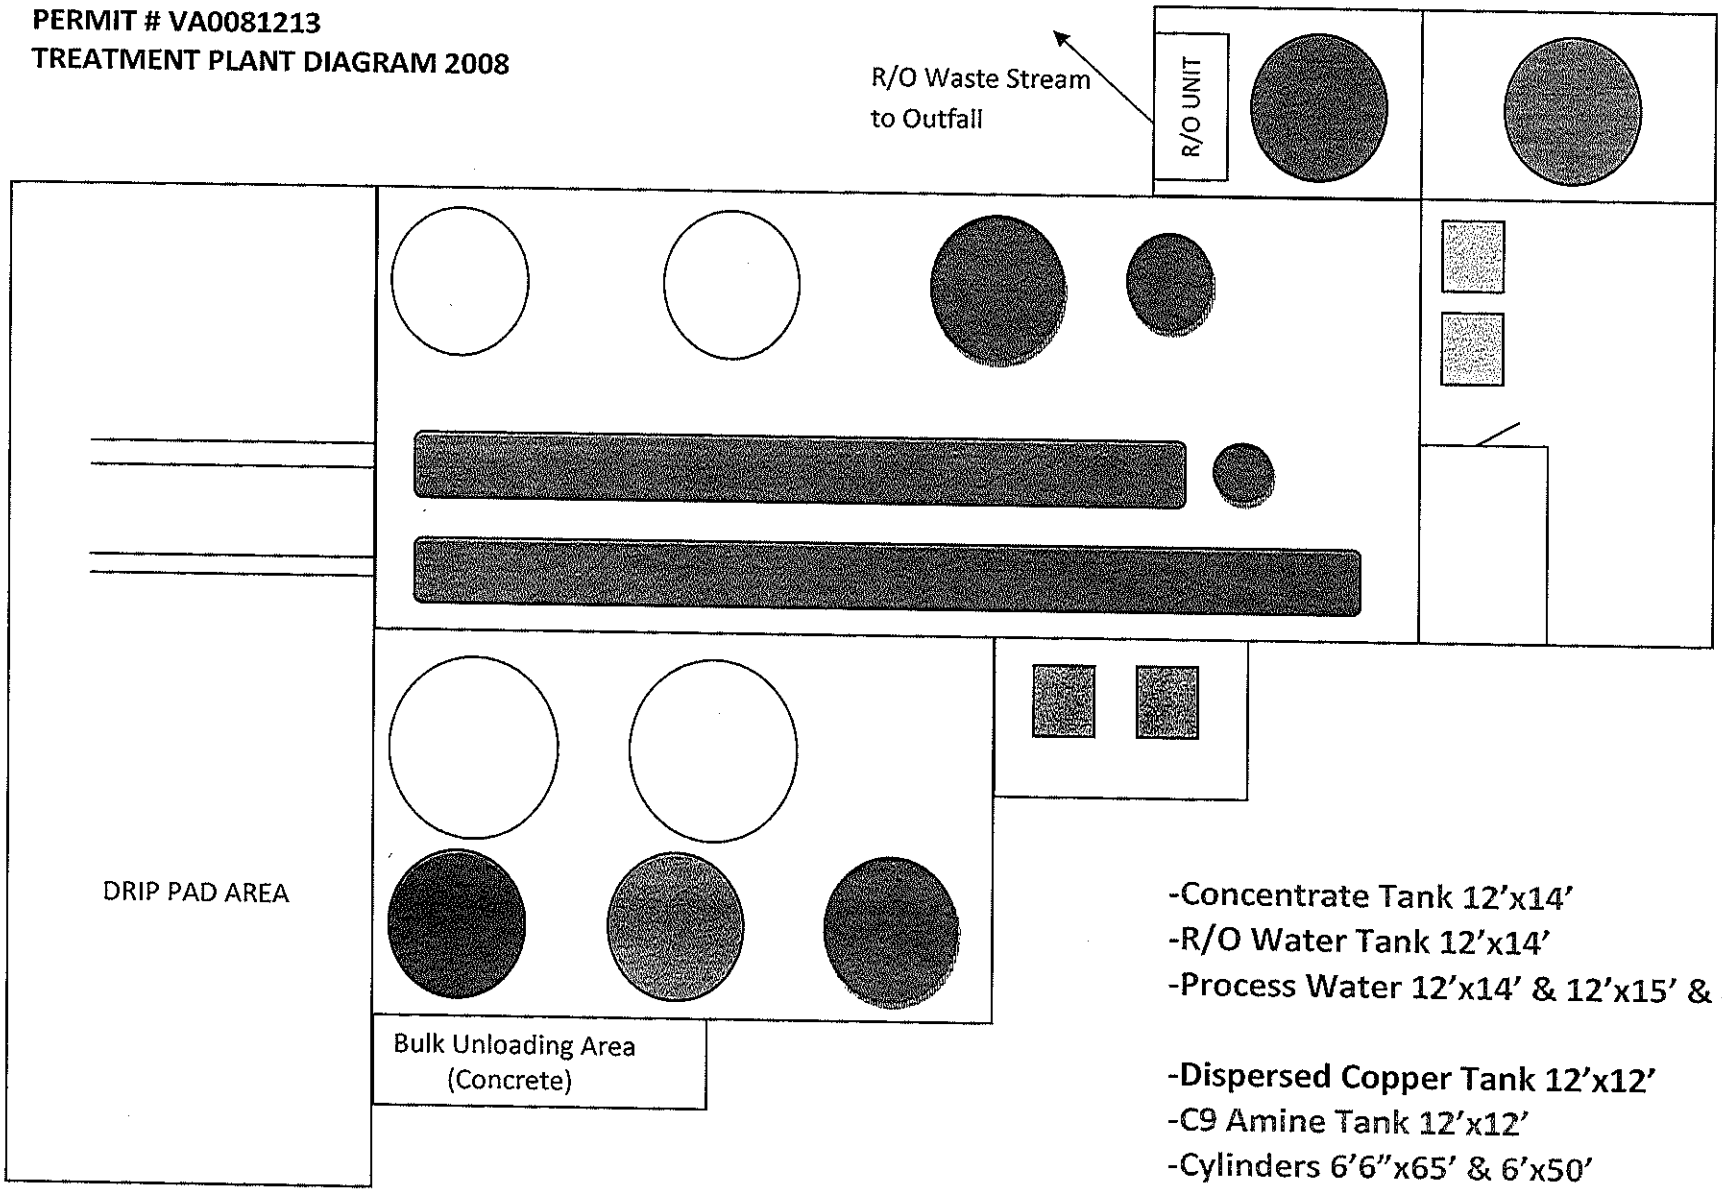

-Concentrate Tank 12'x14'
-R/O Water Tank 12'x14'
-Process Water 12'x14' & 12'x15' & 8'x14'-

-Dispersed Copper Tank 12'x12'
-C9 Amine Tank 12'x12'
-Cylinders 6'6"x65' & 6'x50'
-Totes for Additives
-Moldicide Totes